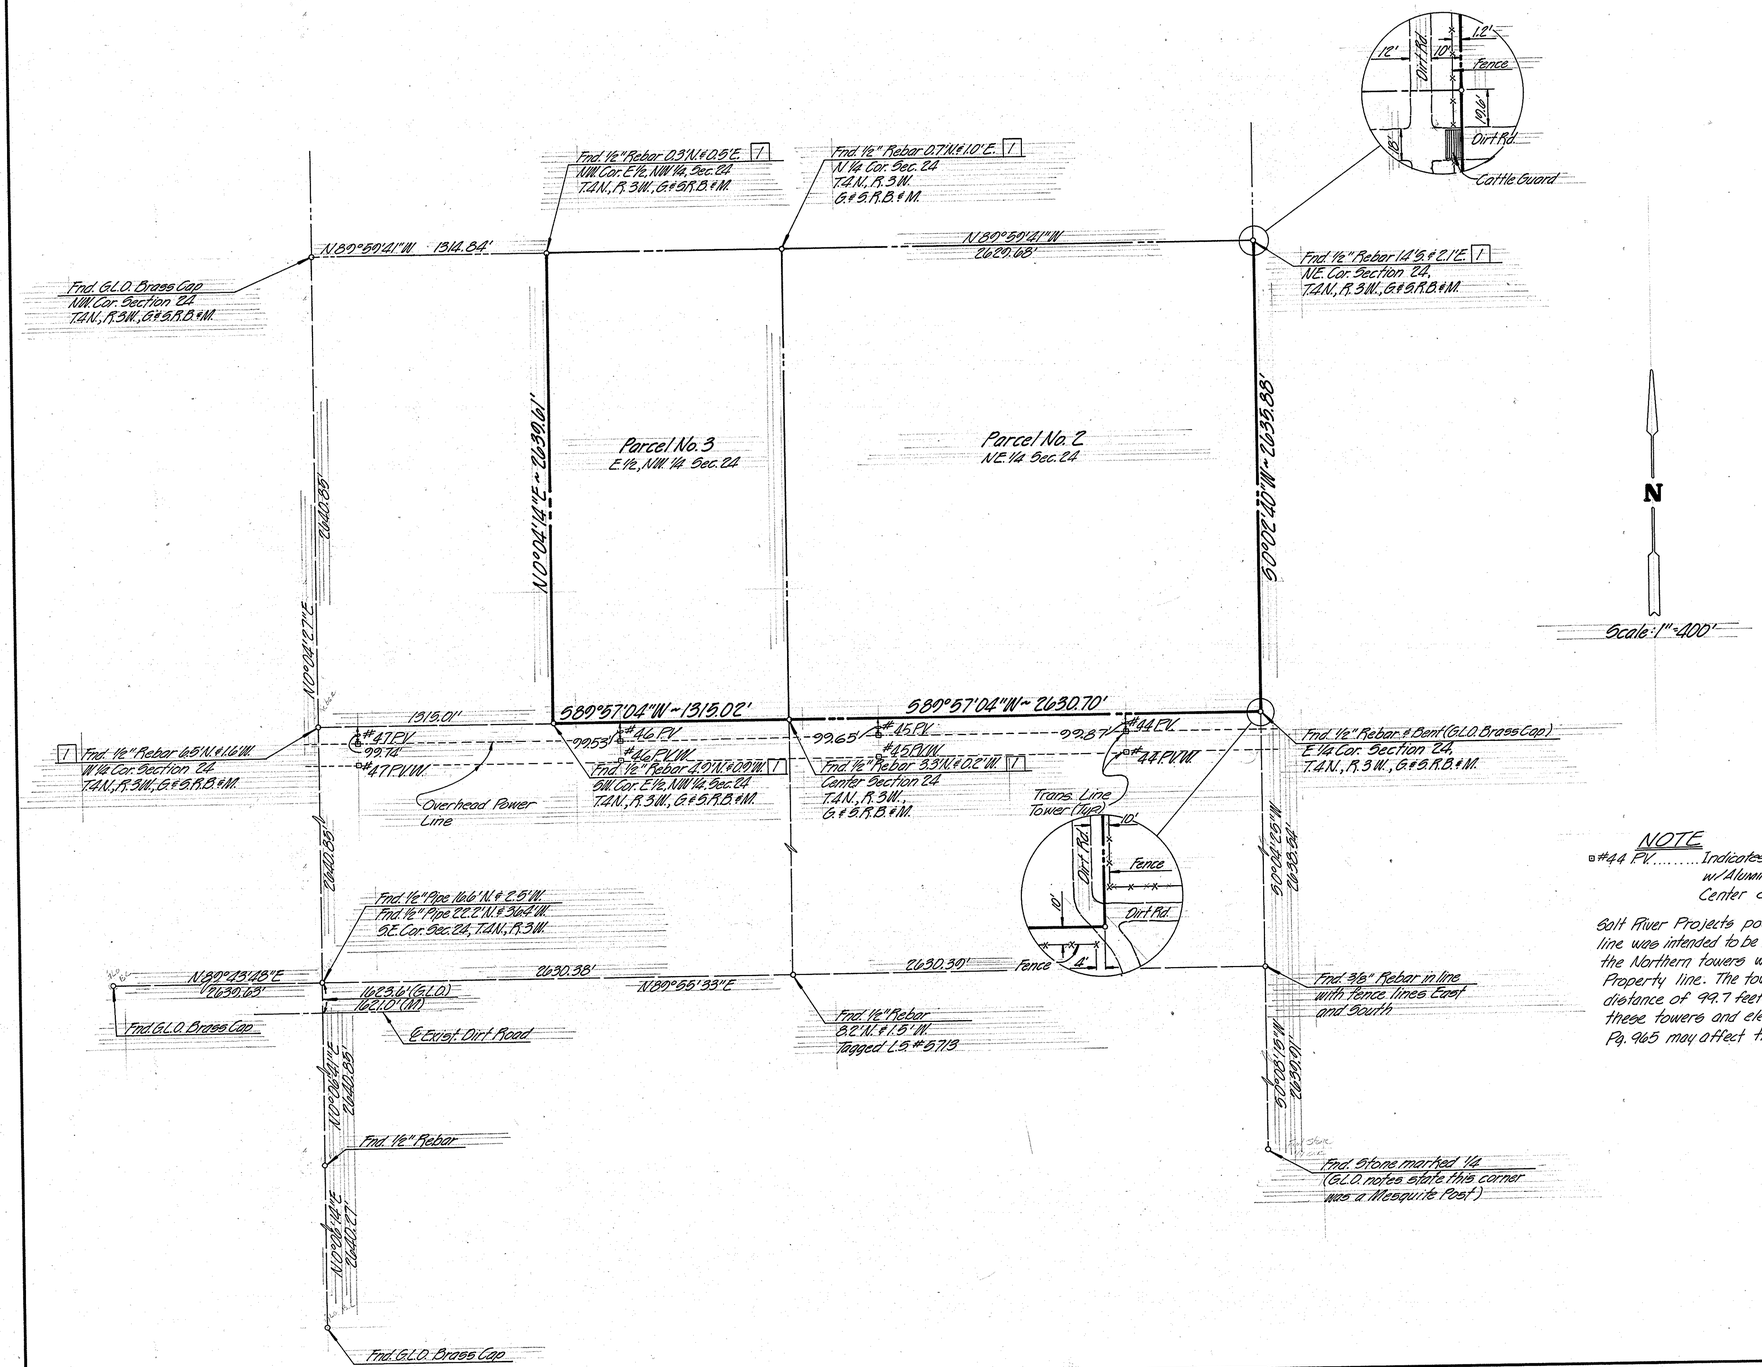


## NOTE

□ #44 P.V. ..... Indicates Fnd. 1/2" Rebar w/Aluminum Cap at Center of Tower

Salt River Projects power line adjacent to the South Property line was intended to be constructed so that the Center line of the Northern towers would be 100 feet South of the South Property line. The towers are actually located an average distance of 99.7 feet South. Therefore the Easement for these towers and electric line according to Dkt. 14633, Pg. 965 may affect the South 0.3 feet of Parcels 2 and 3.

DIN # 56853

REGISTERED LAND SURVEYOR
CERTIFICATE NO. 12531
FRED L. BAKER
Date Signed 5/6/86
ARIZONA, U.S.A.

# A.L.T.A. SURVEY

Section 13 and 24 T.4N., R.3W.
G.&S.R.B.&M.

| DRAWN: BRO | DATE | JOB NO. | SCALE | SHEET |
|---|---|---|---|---|
| CHECK: FLB | April, '86 | 2720 | 1"=400' | 2 OF 3 |

BAKER LAND SURVEYING
4120 N. 20TH ST. PHX., AZ (602) 957-8387